
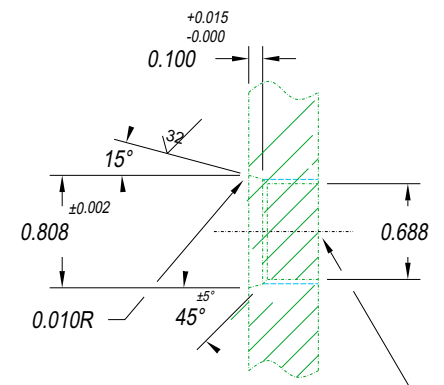
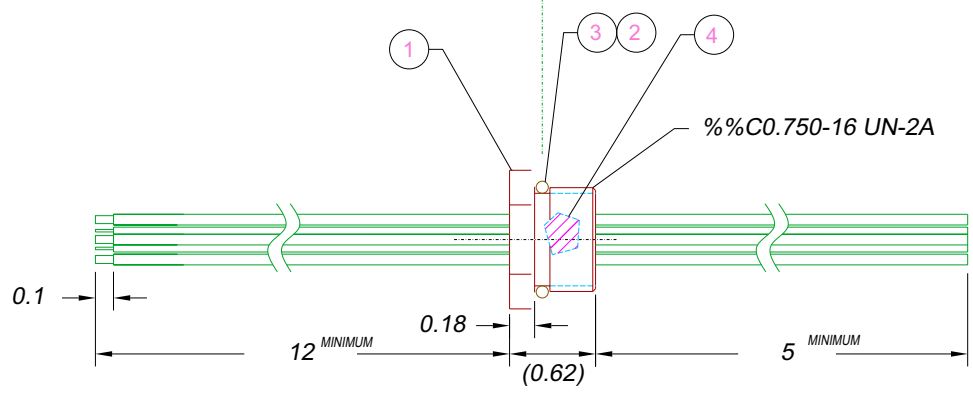


ATMOSPHERE PRESSURE



0.750-16 UN-2B THRU  
**INSTALLATION/  
 LEAK TEST PORT**

**NOTES:**  
 1. LEAK TEST: 80 PSI, NO BUBBLES 1 MINUTE MINIMUM.  
 2. HYPOT 630 VDC 500 MW 0.01 SEC MINIMUM, WIRE TO WIRE & HOUSING.  
 3. ALL TESTS ARE PERFORMED AT ROOM TEMPERATURE.  
 4. BUBBLES ALLOWED AT WIRE ENDS ONLY DURING LEAK TEST.

12	18"	PC26 GRAY	WIRE 26PVC UL1007 .016 7/#34
11	18"	PC26 ORANGE	WIRE 26PVC UL1007 .016 7/#34
10	18"	PC26 BLUE	WIRE 26PVC UL1007 .016 7/#34
9	18"	PC26 YELLOW	WIRE 26PVC UL1007 .016 7/#34
8	18"	PC26 BROWN	WIRE 26PVC UL1007 .016 7/#34
7	18"	PC18 UL1569 RED	WIRE 18PC UL1569 .016 7/#26
6	18"	PC18 UL1569 GRN	WIRE 18PC UL1569 .016 7/#26
5	18"	PC18 UL1569 BLK	WIRE 18PC UL1569 .016 7/#26
4	A/R	PAVE-Seal 150	EPOXY BLACK
3	1	-908 BUNA	O-RING -908 BUNA 90
2	A/R	PARKER O-LUBE	LUBRICANT O-RING BARIUM-BASED
1	1	2248	HOUSING SO12-AL
<b>ITEM</b>	<b>QTY</b>	<b>PART#</b>	<b>DESCRIPTION</b>

ALL DIMENSIONS AND TOLERANCES APPLY TO FINISHED PART IN INCHES  
 ALLOWABLE TOLERANCES UNLESS SPECIFIED OTHERWISE: NONE +/-0.5  
 X DECIMAL +/- 0.1 .XX DECIMAL +/- 0.02 .XXX DECIMAL +/-0.005  
 ANGLES +/- 1 DEG SURFACE FINISH 128 microinch RMS



DESCRIPTION **PAVE-Seal® Cable Harnesses**  
**SO12-AL-80-3/5-PC18/26-12-5**

PART NUMBER  
**2438**

